




RESILIENT SEATED GATE VALVE

Originator: **RCS**

Standards Approval:
Ron Slabaugh

Date: **3/12/2019**

Rev #:	Revision Description:
1	2019 UPDATES

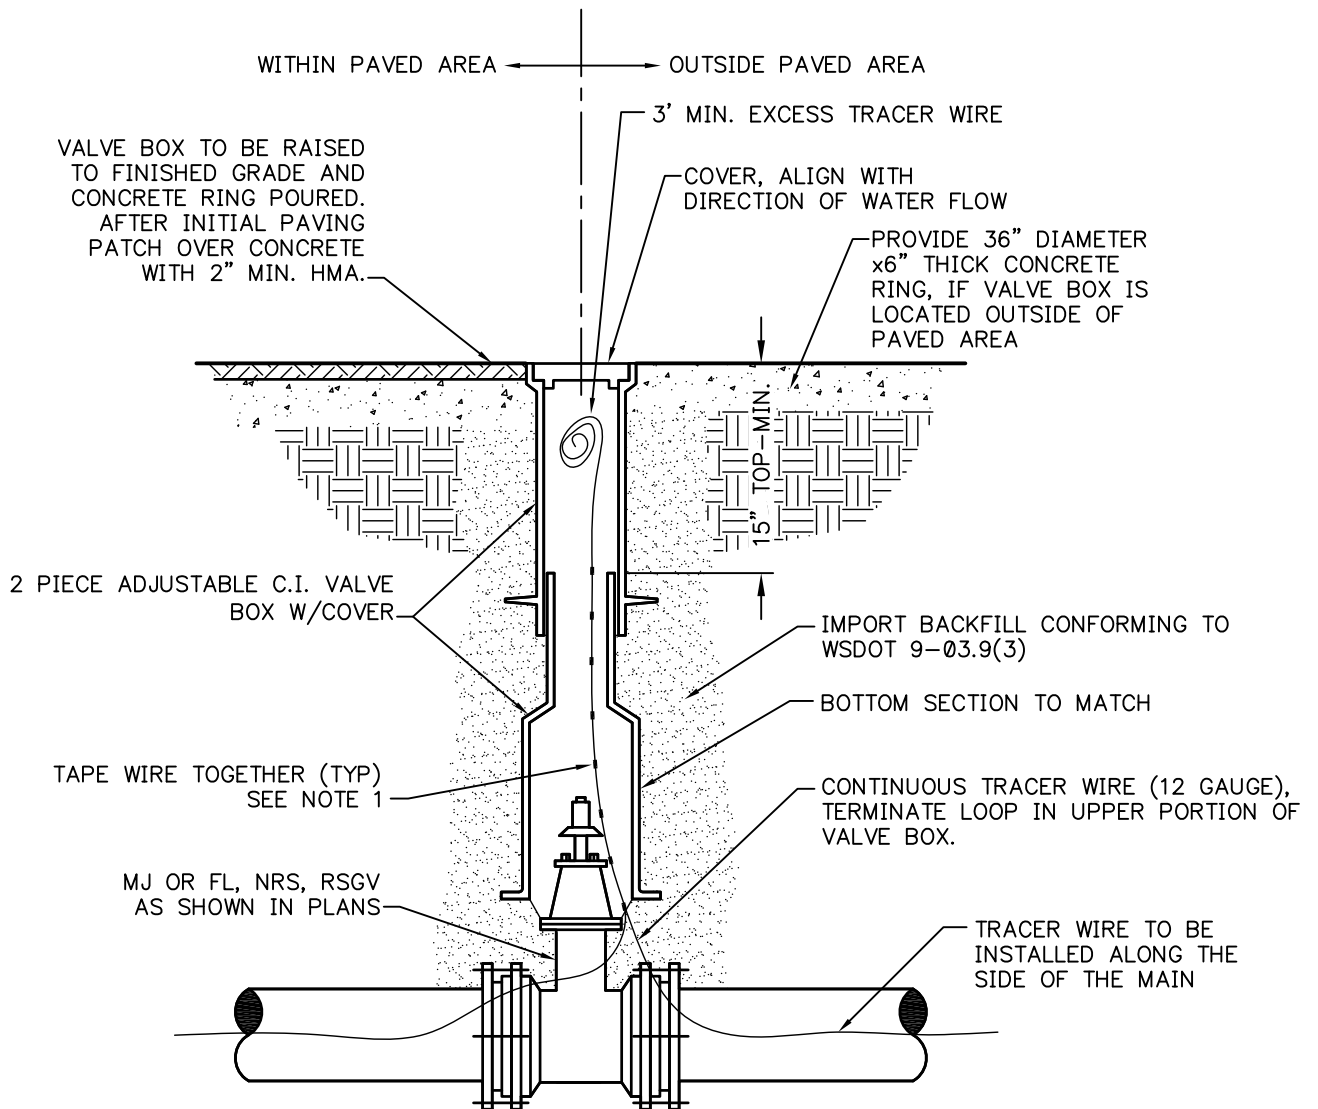

NOTES:

1. TRACER WIRE LOOP TO BE TAPED TOGETHER INSIDE OF THE VALVE BOX EVERY 6 INCHES.
2. PROVIDE 3' OF CLEAR SPACE AROUND VALVE BOX FOR OPERATION.